



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
0	ISSUED FOR REVIEW		

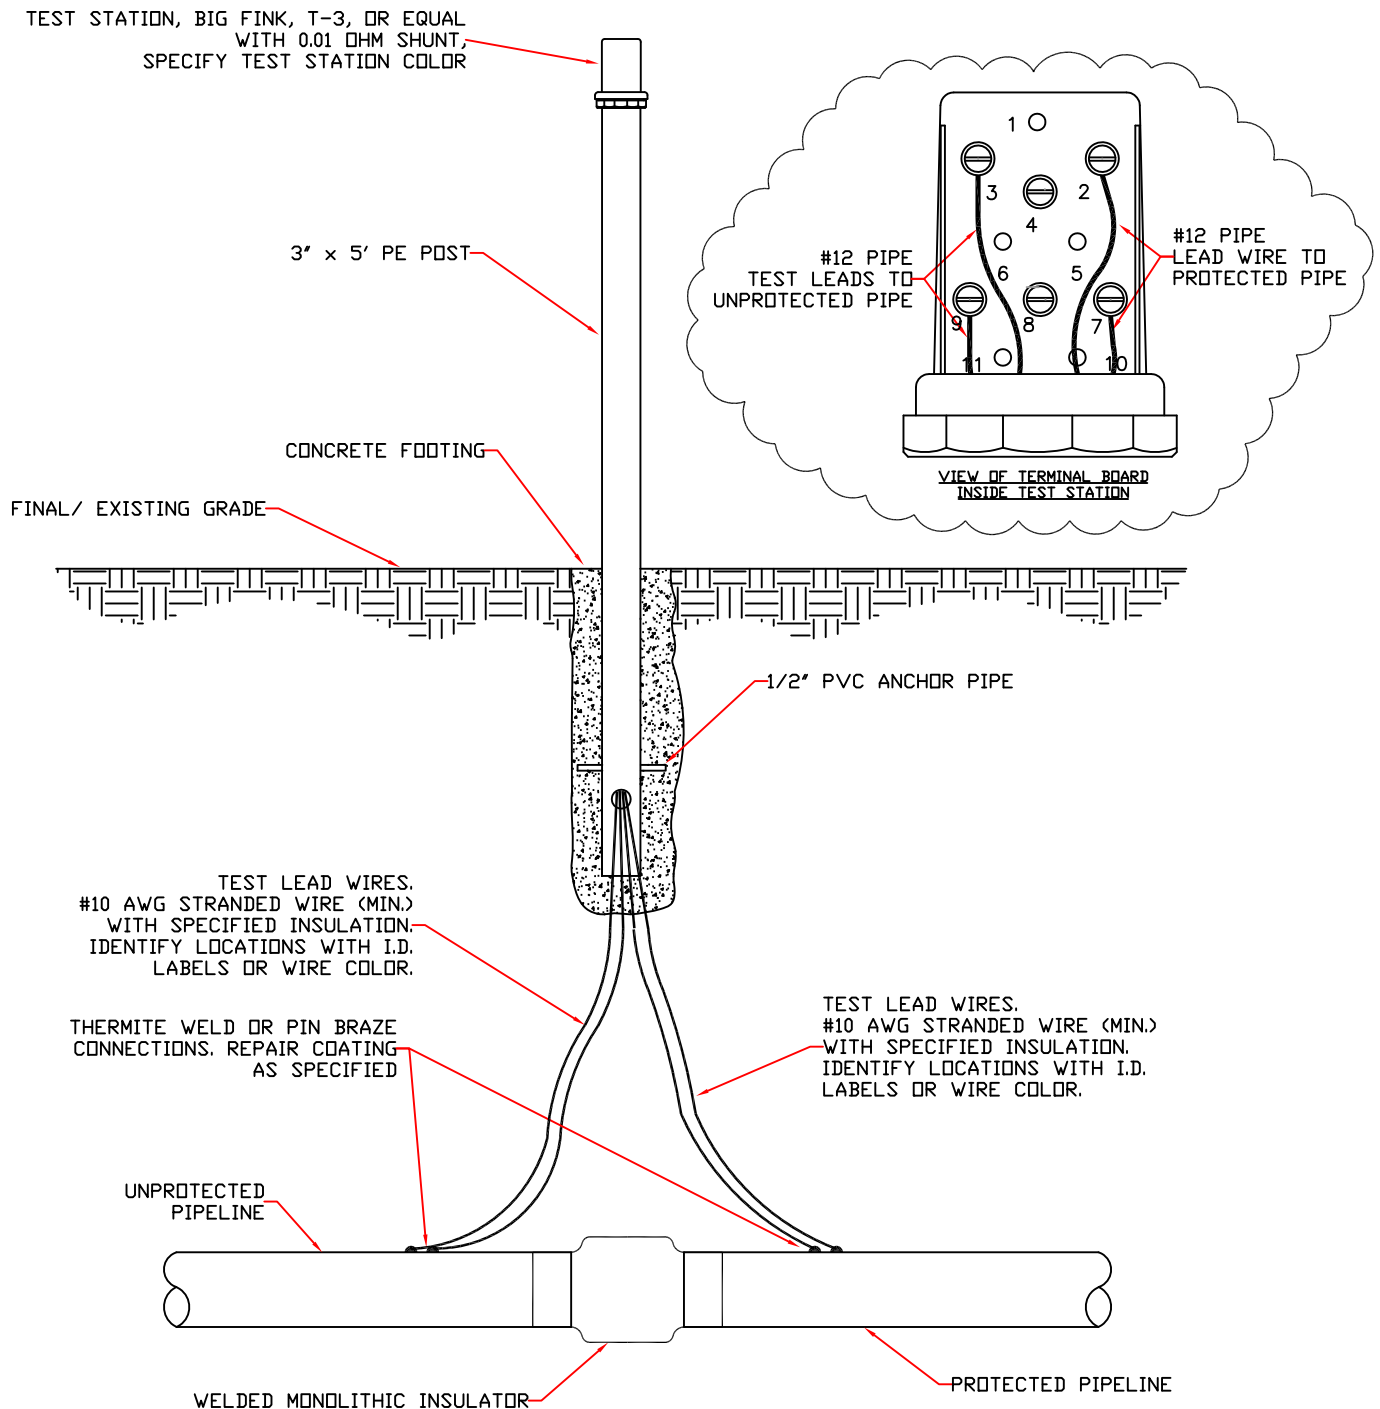

DRAWN BY T.S.H. 12/08		FARWEST CORROSION CONTROL COMPANY 1480 W. Artesia Blvd. Gardena, California	
ENGINEER			
JOB NO.			
		TYPICAL CATHODIC PROTECTION ABOVE GRADE TEST STATION BURIED MONOLITHIC INSULATOR	
		SIZE A	DWG NO. S-2G-MI
		FILE S-2G-MI	SCALE NONE
		REV 0	SHEET 1 of 1