



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
0	ISSUED FOR REVIEW		

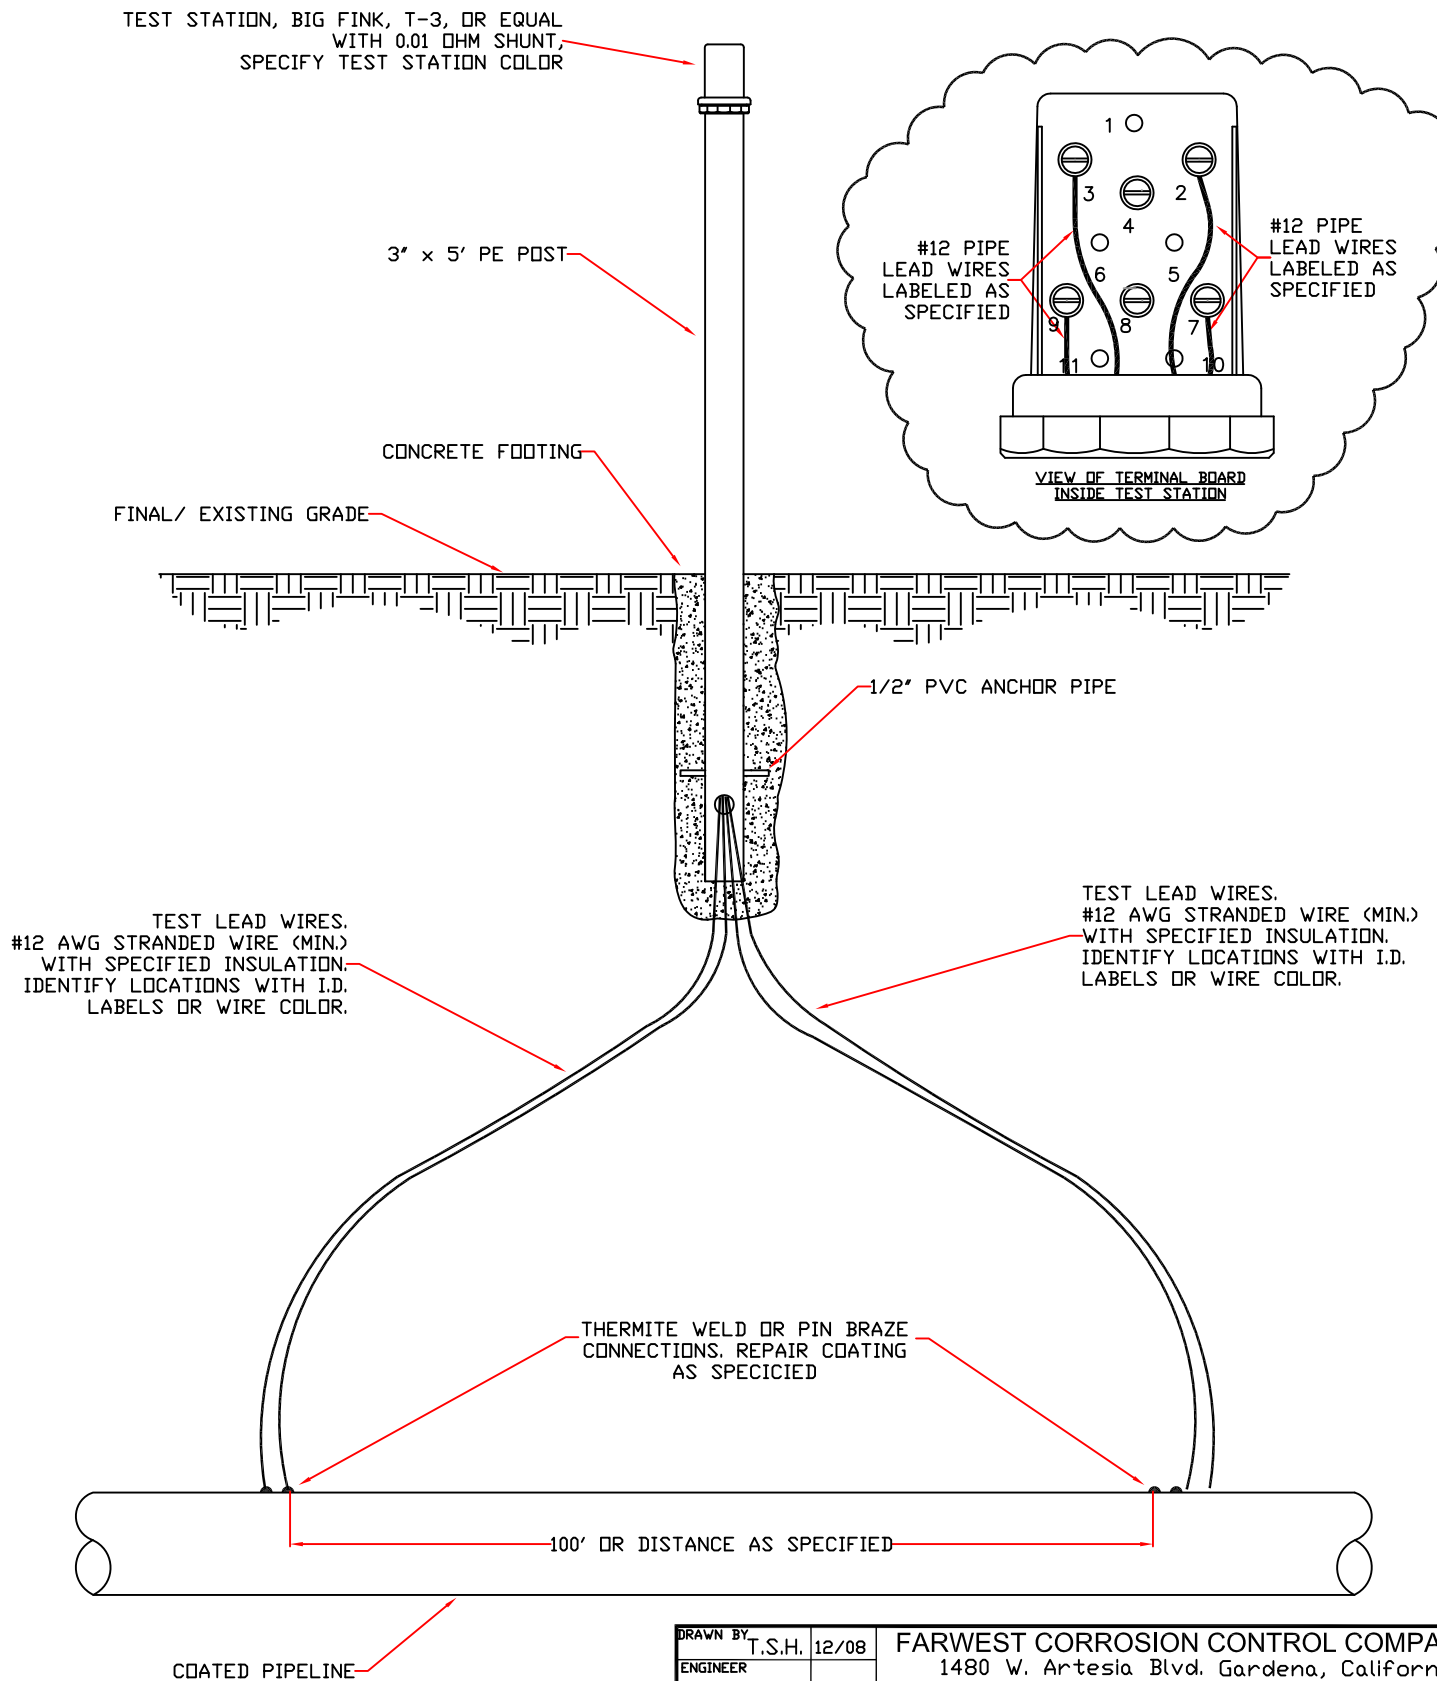

DRAWN BY T.S.H. 12/08		FARWEST CORROSION CONTROL COMPANY 1480 W. Artesia Blvd. Gardena, California	
ENGINEER		TYPICAL CATHODIC PROTECTION ABOVE GRADE TEST STATION LINE DROP/CURRENT	
JOB NO.		DWG NO. S-2D	
		SIZE A	REV 0
		FILE S-2D	SCALE NONE
		SHEET 1 of 1	